


IX-Diagram

Temp. -5°C → +70°C. Fugtig luft ved 101 kPa/760 mm Hg.



A = 20°C / 60% RF
B = 0°C / 100% RF

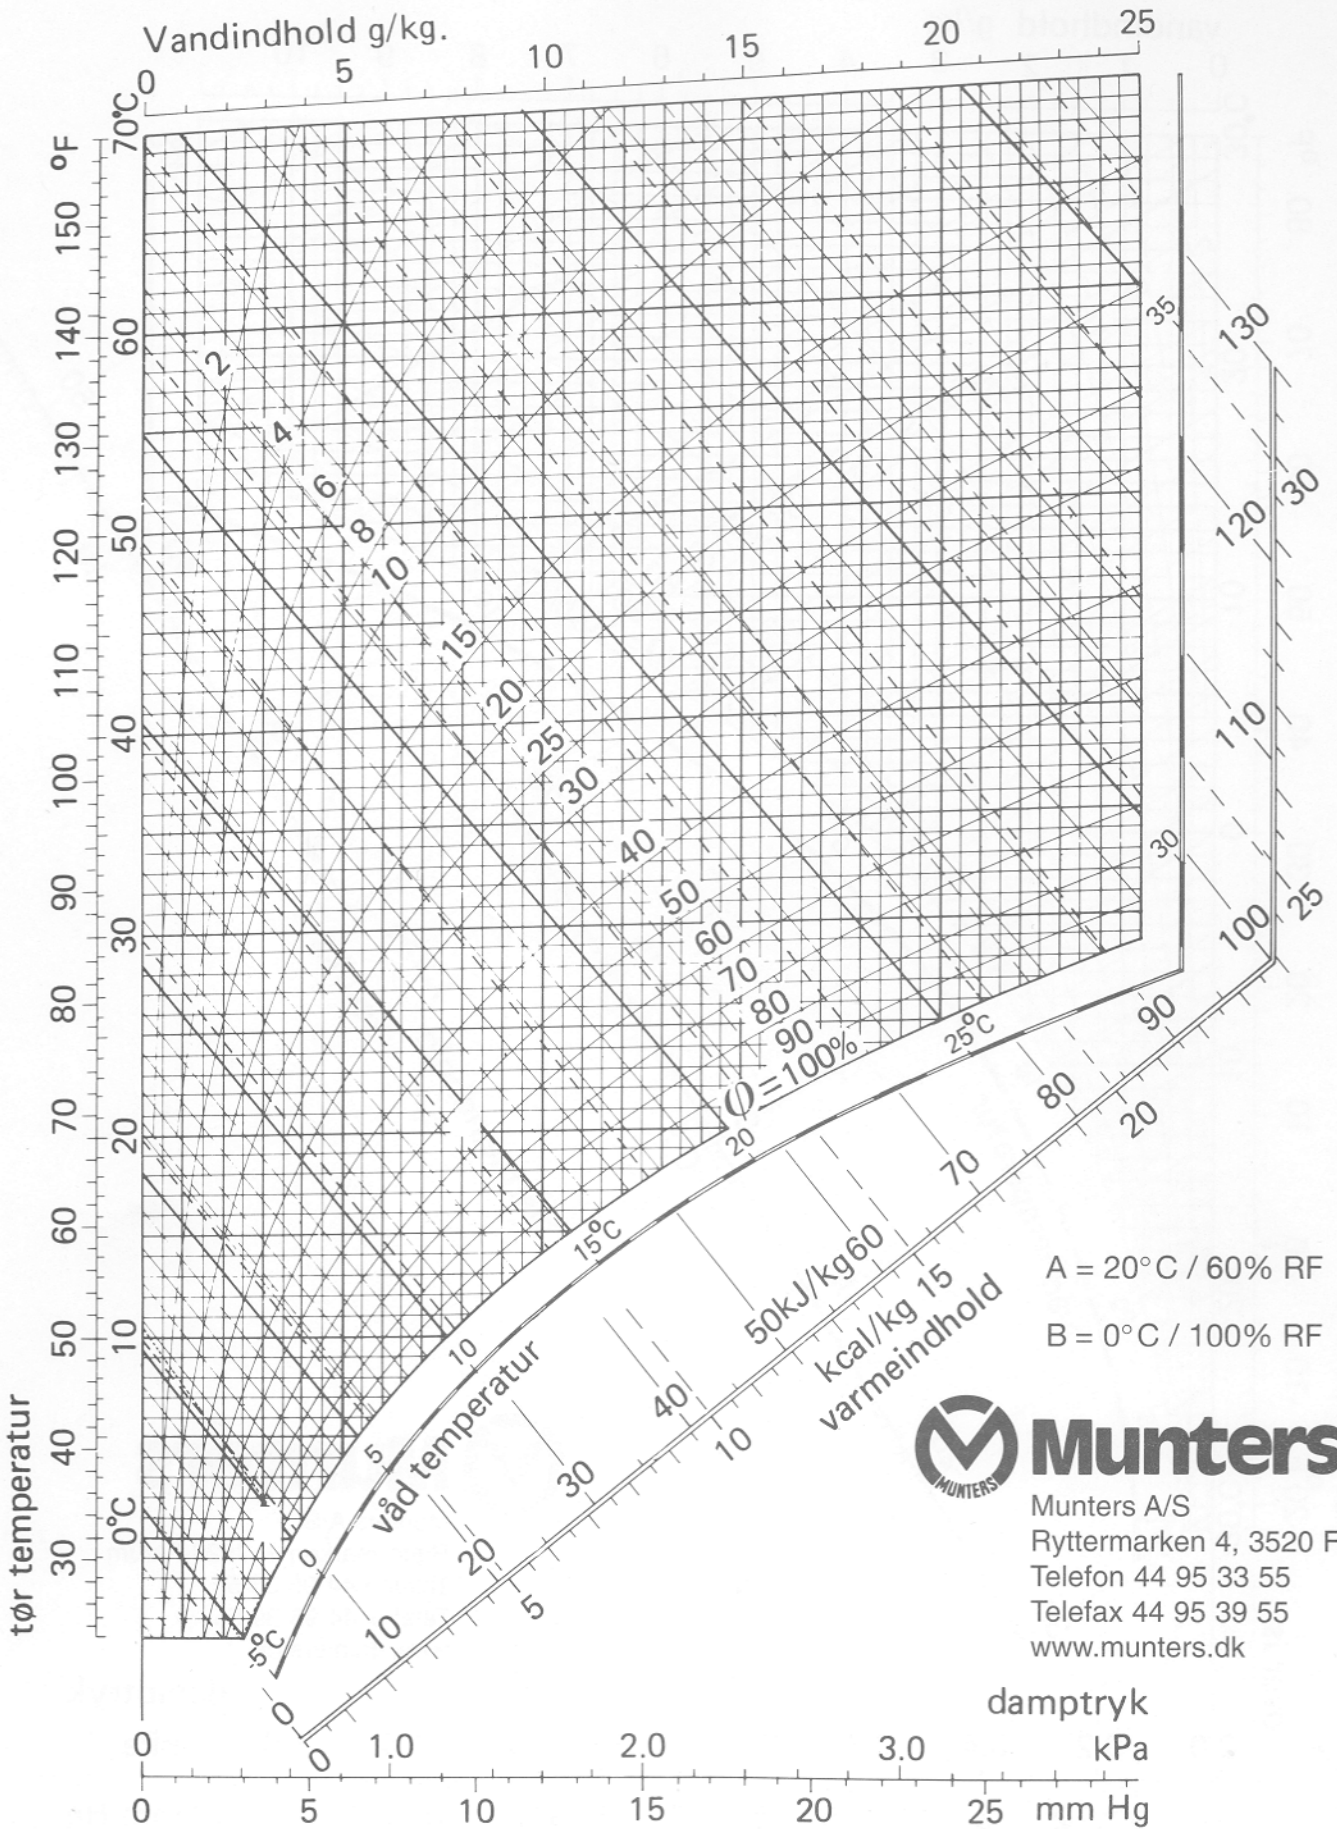

Munters

Munters A/S
Ryttermarken 4, 3520 Farum
Telefon 44 95 33 55
Telefax 44 95 39 55
www.munters.dk

damppryk
kPa
mm Hg